



172 REASER COURT ELYRIA, OHIO 44035 PHONE: 440-365-4567 FAX: 440-365-2100 TOLL FREE PH: 800-854-3267 TOLL FREE FAX: 800-716-1214 WWW.NAKSINC.COM

SALES@NAKSINC.COM

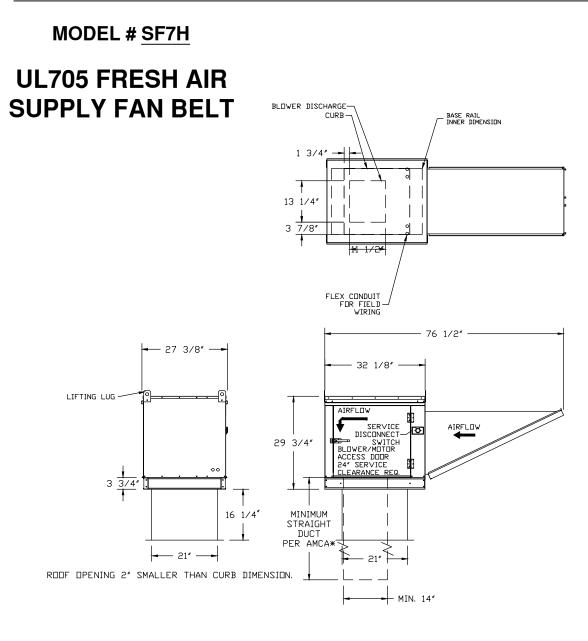

**DIMENSIONAL DATA** 

21" SQ. CURB

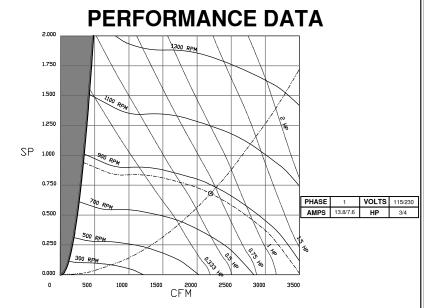

	Static Pressure in Inches W.G.						
	0	0.125	0.25	0.375	0.5	0.625	0.75
CFM	RPM/BHP	RPM/BHP	RPM/BHP	RPM/BHP	RPM/BHP	RPM/BHP	RPM/BHP
500		399 / 0.05	560 / 0.14	678 / 0.25	774 / 0.37	858 / 0.50	931 / 0.64
1000	309 / 0.02	442 / 0.07	573 / 0.15	693 / 0.27	799 / 0.41	892 / 0.57	975 / 0.74
1500	462 / 0.08	552 / 0.13	641 / 0.21	730/0.31	817 / 0.43	902 / 0.58	
2000	616 / 0.19	685 / 0.26	752 / 0.34	818 / 0.44	884 / 0.55	951 / 0.68	
2500	769 / 0.36	825 / 0.45	880 / 0.54	933 / 0.65			

## STANDARD FEATURES

FLEXIBLE FORWARD CURVED BELT DRIVE BLOWERS OPERATE AT LOW SPEED AND LOW NOISE LEVELS GALVANIZED STEEL HOUSING HEAVY DUTY BALL BEARINGS SUITABLE FOR -65° TO +250° F WEATHER PROOF CABINET DESIGNED FOR OUTDOOR ROOF MOUNTING FILTERS DESIGNED WITH LARGE SURFACE AREA FOR EFFICIENT FILTRATION WASHABLE ALUMINUM MESH FILTER ARE LOCATED IN THE INTAKE HOOD AND ARE ACCESSIBLE THROUGH THE HOOD END CAP FOR EASE OF SERVICE EASY ON-SITE ADDITION OF CUSTOMER SUPPLIED AIR SUPPLY DUCT EXTENSION BETWEEN THE INTAKE HOOD AND UNIT PROVIDES ADDITIONAL SEPARATION WHERE NECESSARY MIAMI DADE IMPACT AND WIND CERTIFICATION +30/-130 PSF -MIAMI DADE COUNTY PRODUCT CONTROL APPROVED, FLORIDA BUILDING CODE APPROVAL AVERAGE UNIT WEIGHT: 208 LBS AVERAGE SHIPPING WEIGHT: 240 LBS HURRICANE RATED

MIAMI-DADE COUNTY

APPROVED



14177 11/21