


## Gas-Fired Tempered Make-Up Air Unit

Model:

T2-3400-115-1

1-Phase, 115V, 2.00 HP, Belt driven with Motorized Damper and 12" Blower. MAX 3,400 CFM

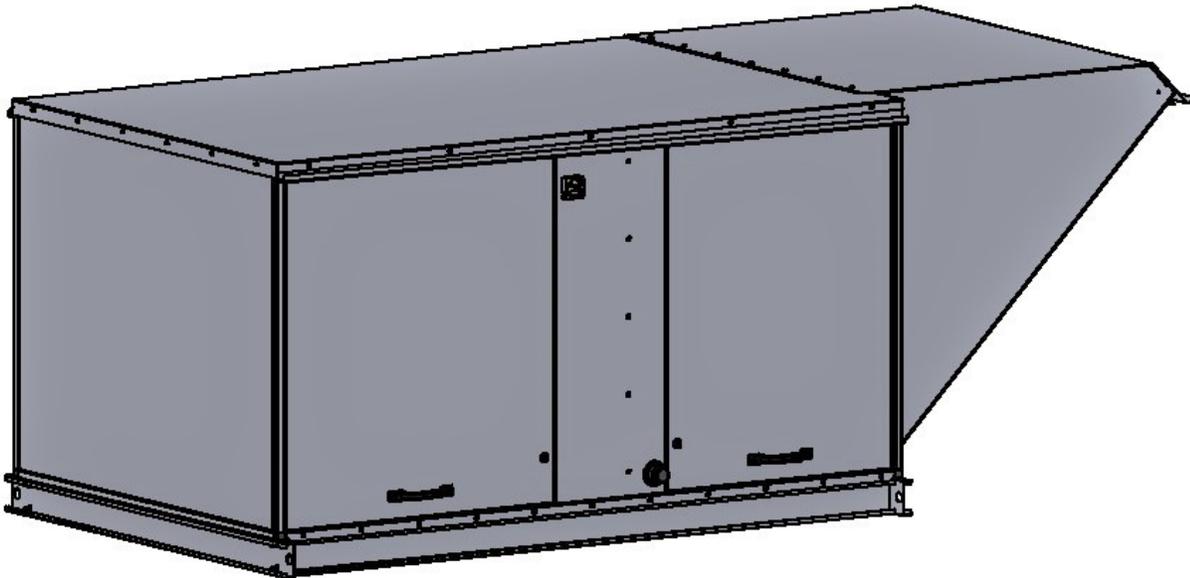



T2-HOX Direct Fired (481 lbs.)

**Supply Motor:**

Model L1322T, 2.00 HP, 115-1-60, 20.4 FLA, ODP (Open Drip Proof)

**Supply Motor Pulleys:**

<u>Part Type</u>	<u>Qty</u>	<u>Browning #</u>	<u>Turns Out</u>
Blower Pulley	1	AK54 x 3/4	
Motor Pulley	1	1VP40 x 7/8	2.0

**Burner:**

Min Output BTU: 18,000 BTU/Hr  
Max Output BTU: 375,000 BTU/Hr  
Size: 6" long  
Gas Type: Natural

**Supply Performance:**

Volume: 3400 cfm Volume Range: 1400-3400 cfm  
RPM: 1072  
TS: 3613 ft/min  
SP: 1.69" w.g.  
0.50" Ext. + 0.80" Int. + 0.39" Opt.  
BHP: 1.74

**Heating Schedule:**

Altitude: 0'  
Winter Entering Air Dry Bulb Temp: 0°F  
Temp Rise: 100°F  
Output BTU: 345,000  
Input BTU: 375,000  
BTUs BASED OFF STANDARD AIR DENSITY

**Supply Installation Information:**

Gas Inlet Pressure: 8 in. w.c. - 14 in. w.c.  
Insurance: FM/ETL

Unit Main Input: 27.5 Amps MCA, 45 Amps MOP, 115 V,  
10 AWG Wire Min.  
Supply Unit Voltage: 115v-1ph-60hz

**Construction Features**

Housing constructed of heavy-duty unpainted G90 galvanized steel • Forward curved centrifugal blower wheel • Vibration isolation • Adjustable drive assemblies • Adjustable motor mount • Ball bearing motors • Heavy duty, pre-lubricated bearings L10 rated for 100,000 hours of operation • Static resistant belts • Service doors on both sides • Horizontal & down discharge • Large intake area ensures low pressure drop across unit • Electronic Burner Profiler System automatically adjusts for any airflow - no manual setting required! • Weatherproof safety disconnect switch • Modular design provides design flexibility • Fully insulated casing

**Blower:**

12" forward curved, centrifugal blower. Permanently lubricated ball bearings. Galvanized finish. 3/4" shaft. 2,500 max. RPM. Used in heated and non-heated supply fans.

**Temp Control:**

Maxitrol Series 14 • 40-90°F Discharge Temp Control • Field Wired On/Off Start Command; Temperature set point dial @ main/unit panel.

**Intake:**

Sloped Filtered Intake for T2 Modular Heater. 28" Wide x 32" Long x 30" High. Includes 2" MV EZ Kleen Metal Mesh Filters.

**Filters:**

2x MV EZ Kleen Metal Mesh Filter. 25"x 20"x 2" Used for heater and supply fan intakes.

**Selected Options:**

- Motorized Inlet Damper 20"W x 23-3/4"H for T2 Modular Heating Units w/Extended Shaft, Standard Galvanized Construction, 3/4" Rear Flange, LMX24-3-S Belimo Actuator Included (with end switch)
- Low Fire Start. Allows the burner circuit to energize when the modulation control is in a low fire position.



Project No:  
Project Name:  
Location:  
Engineer:  
Architect:  
Reference:

Submitted by:

**Equipment Tag**

Contractor:

**Model Information**


Model: G12	Part Number: 9005464	
CFM: 3400	Shaft Diameter: 0.75	Unit Weight: 48
SP: 1.69	Wheel Diameter: 12.875	Ship Weight: 52
RPM: 1072	Tip Speed: 3613 FPM	
BHP: 1.74	Static Efficiency: 52	Elevation: 0
	Outlet Velocity: 2332 FPM	Temperature: 70

**Sound Data**

	63	125	250	500	1000	2000	4000	8000	(Hz)	LwA: 85
Sound Power Level @ Frequency, re: 10 <sup>-12</sup> Watts	89	91	86	82	77	77	74	71	(dB)	SONES: 24.8
	Ducted inlet <u>or</u> ducted outlet dBA @5 ft. 74					Ducted inlet <u>and</u> ducted outlet dBA @5 ft. 54				


**Performance Curve**

DELHI Model G12  
CFM=3400 SP=1.69 BHP=1.74 S. Eff=52% RPM=1072

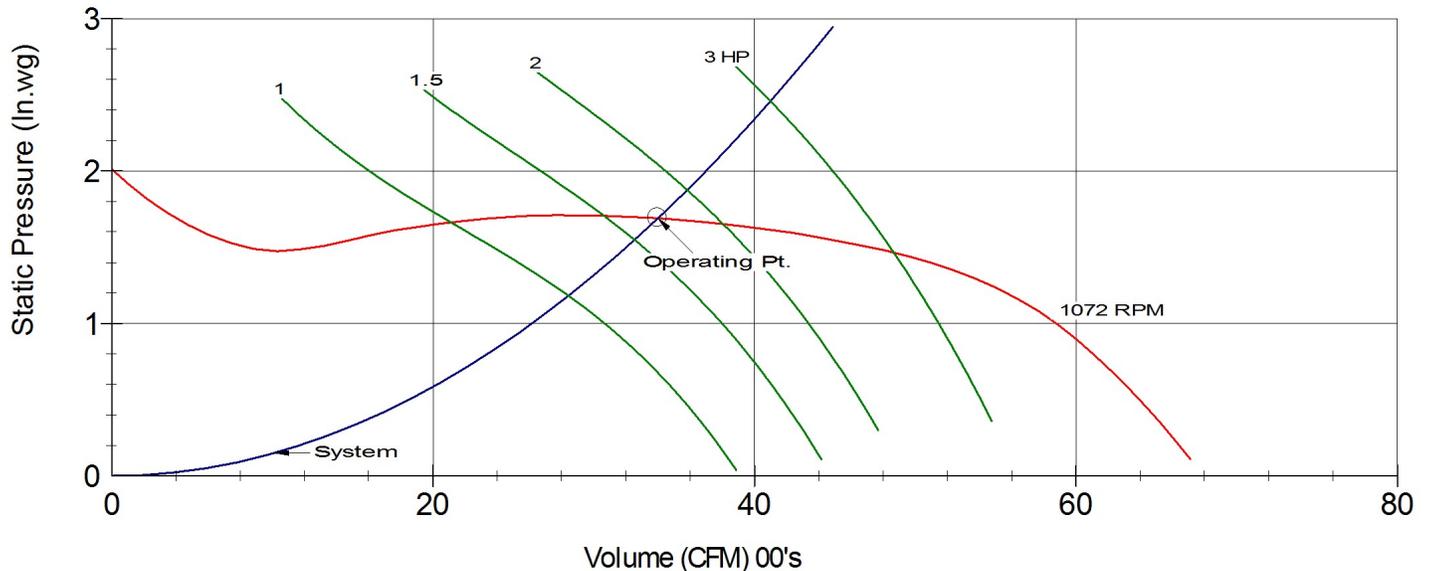

Performance shown is for installation Type B: Free inlet, Ducted outlet. Power rating bhp does not include transmission losses. Performance ratings do not include the effects of appurtenances (accessories).  
v: 13.0.35

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100  
101  
102  
103  
104  
105  
106  
107  
108  
109  
110  
111  
112  
113  
114  
115  
116

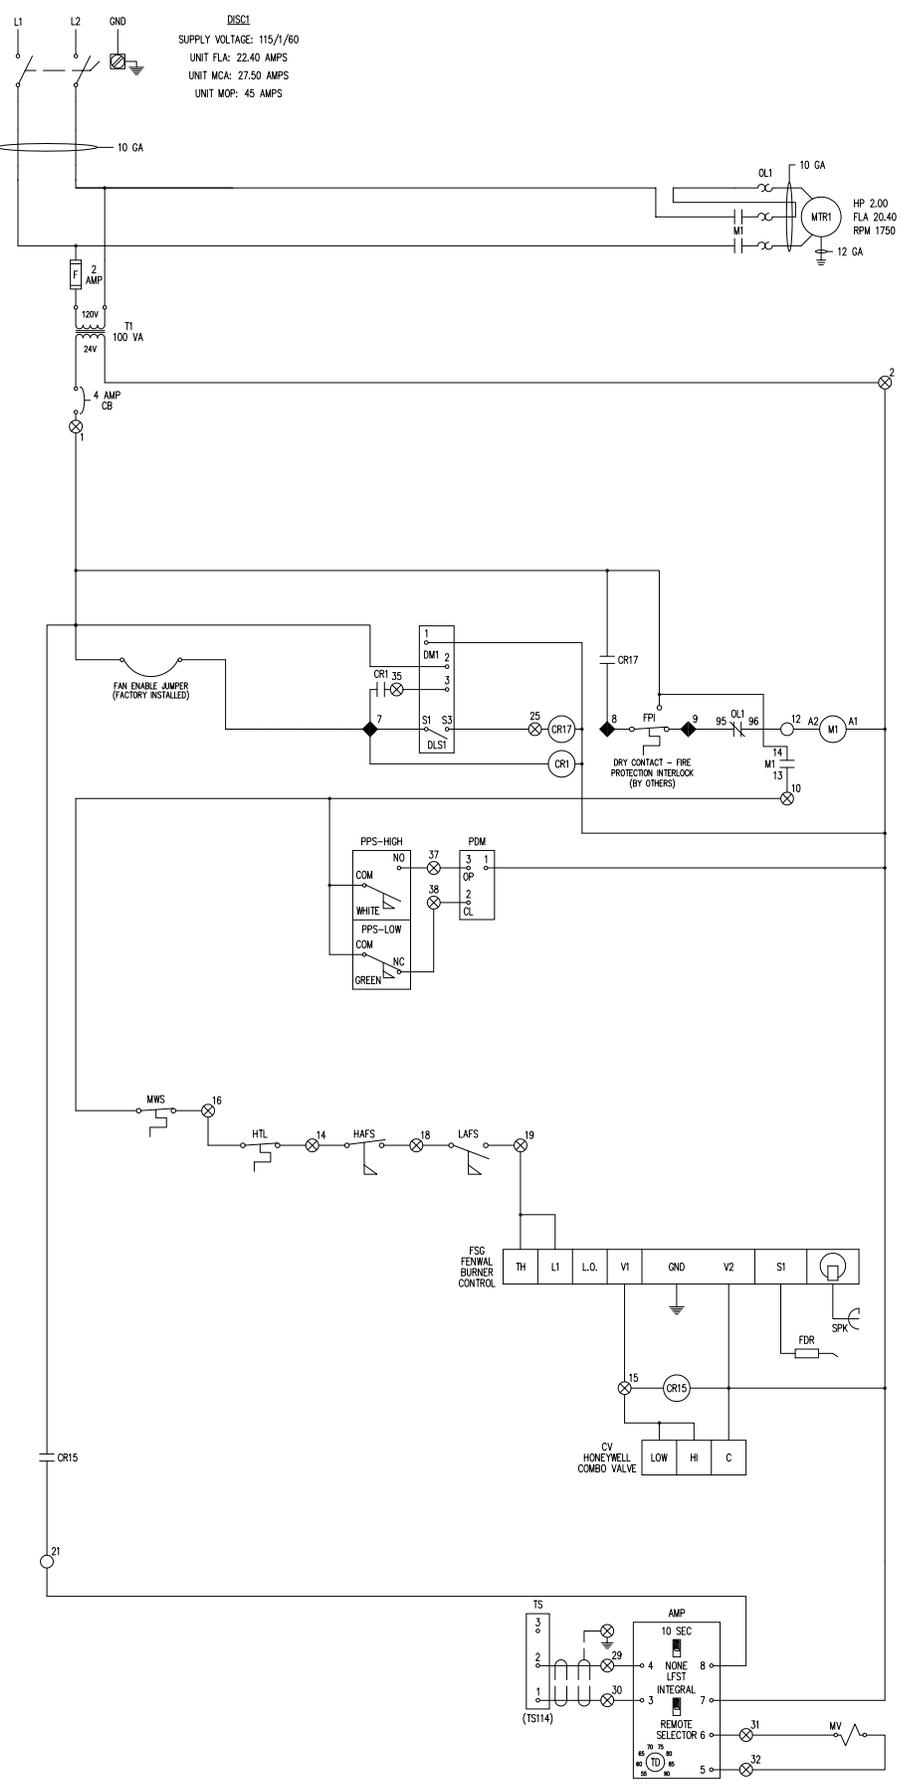

PROPRIETARY

PLEASE NOTE

DISCONNECT SWITCH

SUPPLY FAN MOTOR OVERLOAD RELAY

SUPPLY FAN MOTOR

CONTROL TRANSFORMER

CIRCUIT BREAKER

INLET DAMPER MOTOR

FAN ENABLE JUMPER

DAMPER LIMIT SWITCH

SUPPLY FAN MOTOR CONTACTOR

DAMPER RELAY

UNIT ENABLE RELAY

PROFILE PRESSURE SWITCH (HIGH)

PROFILE DAMPER MOTOR

PROFILE PRESSURE SWITCH (LOW)

MILD WEATHER STAT

HIGH TEMPERATURE LIMIT SWITCH  
HIGH AIR FLOW SWITCH  
LOW AIR FLOW SWITCH

FLAME SAFEGUARD CONTROL

SPARK IGNITOR

FLAME DETECTION ROD

BURNER ON RELAY

DIRECT IGNITION COMB. GAS VALVE

TEMPERATURE CONTROL AMPLIFIER

DISCHARGE TEMPERATURE SENSOR

MODULATING GAS VALVE

TEMPERATURE DIAL

ALL FIELD WIRING SHALL BE THWN, THHN OR MTW WIRE TYPE (OR SHIELDED CABLE WHERE NOTED ON SCHEMATIC) RATED FOR 75° C AND LABELED OR IDENTIFIED AT EACH END FOR EACH CONNECTION BEING MADE. WIRING SHALL BE INSTALLED PER NEC AND LOCAL CODE REQUIREMENTS

ALL CONTROL WIRING SHALL BE AS FOLLOWS:

GAUGE	MAX DISTANCE
18	50'
16	75'
14	150'
12	250'

\* DO NOT RUN LINE VOLTAGE WIRES WITH CONTROL WIRES \*

LEGEND

SYMBOL	DEFINED AS
	(GND) EARTH GROUND GALV. ZINC, MAGNESIUM ROD
	WIRE NUMBERS
	TERMINALS IN CONTROL PANEL
	TERMINALS IN REMOTE PANEL
	REMOTE PANEL WIRING
	FIELD WIRING BETWEEN TERMINALS IN REMOTE PANEL & TERMINALS IN UNIT CONTROL PANEL
	SHIELDED CABLE
	FIELD INSTALLED & WIRED
	FIELD CONNECTION

UNIT SET POINTS

DEVICE	RECOMMENDED SETTING:
HAFS / LAFS	1.00" / 0.40" WC
HTL	130° F
MWS	65° F
PPS-HIGH	CLOSES ABOVE 0.75" WC
PPS-LOW	CLOSES BELOW 0.60" WC
-	-
-	-
-	-
-	-
-	-
-	-

REVISIONS

REV.	DATE	REV. BY
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-
-	-	-







PROJECT INFORMATION

PROJECT NAME:	-
MODEL NO.:	T2-HOX
SERIAL NO.:	-
TAG:	-
DATE:	08-2020
SCALE:	NONE
DRAWN BY:	BMA
DRAWING NO.:	T2-3400-115-1

115-1-60

208/230-1-60

208/230/460/575-3-60

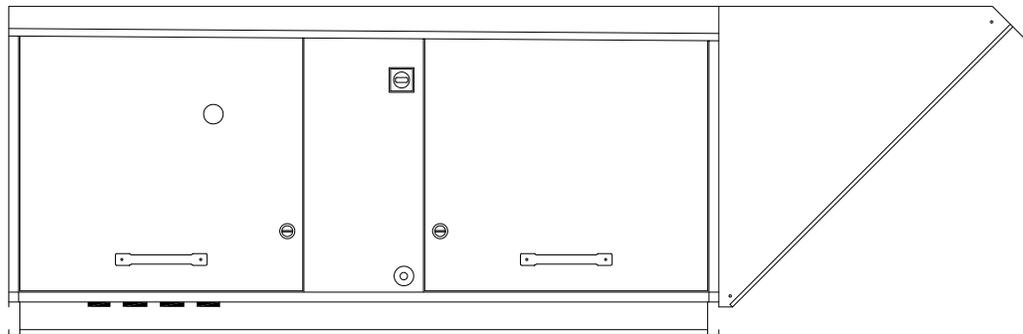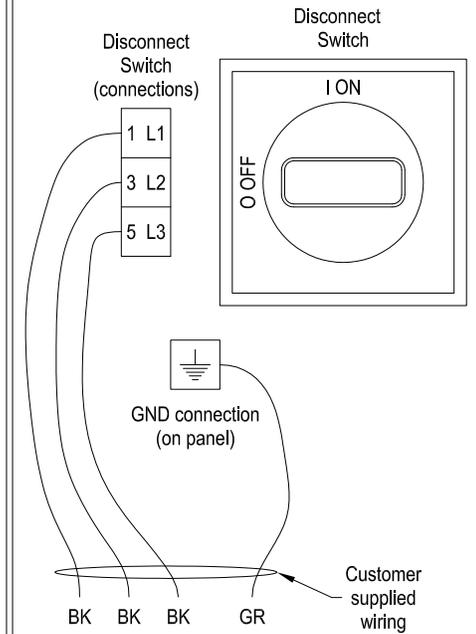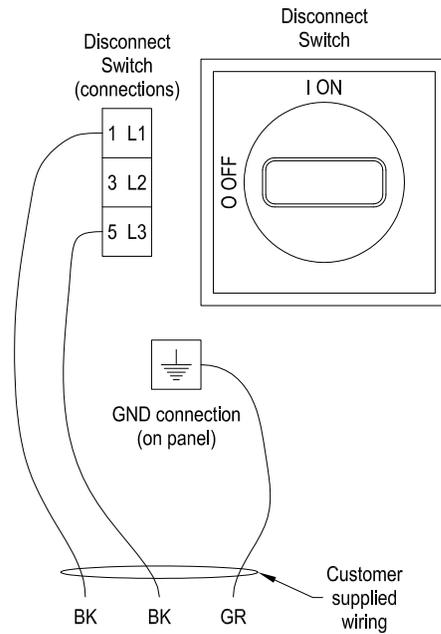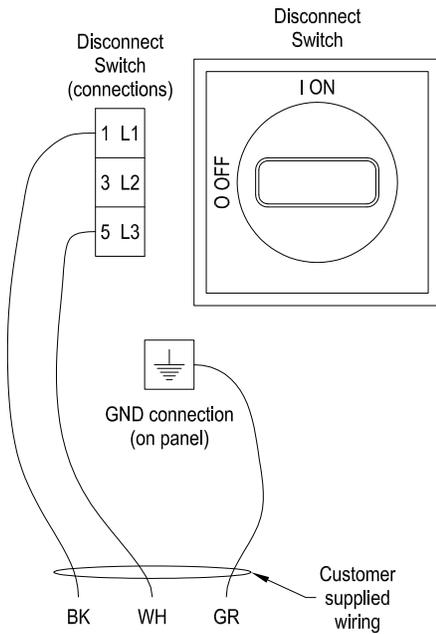

Power Connection  
(see above for details)

Control Connection  
(see below for details)

Connect to  
Terminal 1

Connect to  
Terminal 7



Fan Switch / Interlock  
Field provided BY OTHERS



PROJECT NAME: NAKS T1-T5 DIRECT FIRED MUA INSTALLATION WIRING

REF. NO./JOB NO.: -

MODEL: T1-T5

TAG: -

DRAWN BY: -

DATE: 06-2020

SCALE: NONE

CERTIFIED BY:

DRAWING NO.:

T1-T5\_INSTALL