


Gas-Fired Tempered Make-Up Air Unit / DX

Model:

TK3-DX-3PH-FF

3-Phase, 460V, 7.50 HP, Belt driven with Motorized Damper and 18" Blower. MAX 7000 CFM's

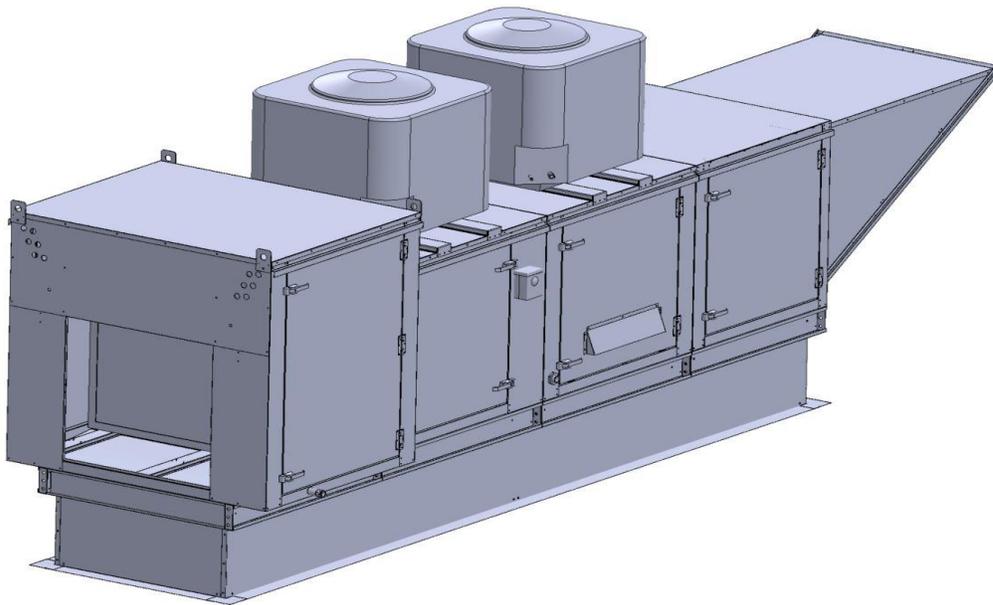



TK3-750 Direct Fired MPU (2515 lbs./142 curb)

Supply Motor:

Model DTP7/54, 7.500 HP, 3 Phase, 460 V, 60Hz, 9.6 FLA, ODP, Premium (E-Plus3) Eff.

Supply Motor Pulleys:

Part Type	Qty	Browning #	Turns Out
Belt	2	BX62	
Blower Pulley	1	2BK90H	
Motor Pulley	1	2VP60 x 1-3/8	3.0

Burner:

Min Output BTU: 27,500 BTU/Hr
Max Output BTU: 825,000 BTU/Hr
Size: 18" long
Gas Type: Natural

Supply Performance:

Volume: 7000 cfm
RPM: 1062
TS: 5005 ft/min
SP: 1.719" w.g.
0.500" Ext. + 0.277" Int. + 0.942" Opt.
BHP: 6.123

Heating Schedule:

Altitude: 0'
Winter Entering Air Dry Bulb Temp: 0°F
Temp Rise: 100°F
Output BTU: 756000
Input BTU: 821739
BTUs BASED OFF STANDARD AIR DENSITY

Cooling Schedule:

DX Coil Entering Dry Bulb Temperature: 86°F
DX Coil Entering Wet Bulb Temperature: 72°F
DX Coil Leaving Dry Bulb Temperature: 72°F
DX Coil Leaving Wet Bulb Temperature: 66°F
DX Coil Total Capacity: 157.3 MBH
DX Coil Sensible Capacity: 104.6 MBH
DX Coil Latent Capacity: 52.7 MBH
Temperature drop calculations are based on tested data.

Supply Installation Information:

Gas Inlet Pressure: 7 in. w.c. - 14 in. w.c.
Insurance: No Insurance Requirement (ANSI)
Unit Main Input: 12.6 Amps MCA, 20 Amps MOP, 460 V, 14 AWG Wire Min.
Condenser #1: 10.5 Amps MCA, 15 Amps MOP, 460, 14 AWG Wire Min.
Condenser #2: 10.5 Amps MCA, 15 Amps MOP, 460, 14 AWG Wire Min.
Condenser #3: 10.5 Amps MCA, 15 Amps MOP, 460, 14 AWG Wire Min.
Supply Unit Voltage: 3 phs 460 V 60Hz

Construction Features

Housing constructed of heavy duty G90 galvanized steel • Forward curved centrifugal blower wheel • Vibration isolation • Adjustable drive assemblies • Adjustable motor mount • Ball bearing motors • Heavy duty, pre-lubricated bearings rated for 200,000 hours of operation • Static resistant belts • Service doors on both sides • Horizontal & down discharge • Large intake area ensures low pressure drop across unit • Spring loaded profile plates automatically adjust for any airflow - no manual setting required! • Weatherproof safety disconnect switch • Modular design provides design flexibility • Fully insulated casing

Blower:

18" forward curved, centrifugal blower. Pillow Block ball bearings. Galvanized finish. 4000-12000 CFM. 1-3/16" x 34" Shaft. 1450 max. RPM. Used in heated and non-heated supply fans.

Temp Control:

RTC Solutions • 40-90°F Discharge Temp Control • Field Wired On/Off Start Command

Intake:

Sloped Foam Filtered Intake for Size #3 Modular Heater. 37.25" Wide X 51.625" Long X 35.188" High. Includes 2" Foam EZ Kleen Metal Mesh Filter.

Filters:

6x EZ Kleen Non-Woven Polyester Metal Mesh Filter. 16"x 20"x 2" Old Part# 97938660 Used for heater and supply fan intakes. 23 layers of expanded aluminum and one layer of non-woven polyester. (3422)

Curb & Supports:

RAIL - 6" Width X 35" Length X 20" Height
RAIL - 6" Width X 35" Length X 20" Height
ROOF CURB - 35" Width X 84" Length X 20" Supply Height, Insulated

Selected Options:




- Motorized Back Draft Damper 30" X 30" for Size 3 Standard & Modular Heater Units w/Extended Shaft, Standard Galvanized Construction, 3/4" Rear Flange, Low Leakage, NFBUP-S Actuator Included
- Low Fire Start. Allows the burner circuit to energize when the modulation control is in a low fire position.
- Gas Pressure Gauge, 0-35", 2.5" Diameter, 1/4" Thread Size
- Gas Pressure Gauge, -5 to +15 Inches Wc., 2.5" Diameter, 1/4" Thread Size
- DX Cooling Intake Air Thermostat and Relays Mounted in Unit - Set Point For Thermostat Should Be 85°F.
- Support shell for Size 3 Modular Package Unit for Third Condenser. Includes control vestibule. Includes condenser supports. Does not include return air or inlet air damper.
- 15 Ton, 3 Circuit (5/5/5) Modular Packaged Cooling Option for Size 3 Modular Packaged Unit. Includes Condenser, DX Coil, Filter/Dryer Kit, Hard Start Kit, Thermal Expansion Valve, R410A Refrigerant, and Refrigerant Piping. (5,400 to 7,000 cfm) NOT BUILT

WITH OPPOSITE SIDE CONTROLS OR OPPOSITE AIRFLOW
DIRECTION. CONDENSERS REQUIRE SEPARATE 460V, 3 PHASE
POWER SUPPLY UNLESS ORDERED WITH SINGLE POINT
CONNECTION. Coil = 3EZ1002B


- Downturn Plenum for Size 3 Cooling Coil Module - Required for
Down Discharge Cooling Coil Applications

- TK3 DIRECT FIRED HEATER WITH DX COOLING
1. DIRECT GAS FIRED HEATED MAKE UP AIR UNIT WITH 18" BLOWER AND 12" BURNER.
 2. INTAKE HOOD WITH EZ FILTERS
 3. DOWN DISCHARGE - AIR FLOW RIGHT → LEFT
 4. MOTORIZED BACK DRAFT DAMPER 30" X 30" FOR SIZE 3 STANDARD & MODULAR HEATER UNITS W/EXTENDED SHAFT. STANDARD GALVANIZED CONSTRUCTION, 3/4" REAR FLANGE, LOW LEAKAGE, NFBUP-S ACTUATOR INCLUDED
 5. LOW FIRE START: ALLOWS THE BURNER CIRCUIT TO ENERGIZE WHEN THE MODULATION CONTROL IS IN A LOW FIRE POSITION.
 6. GAS PRESSURE GAUGE, 0-35", 2.5" DIAMETER, 1/4" THREAD SIZE
 7. GAS PRESSURE GAUGE, -5 TO +15 INCHES WC., 2.5" DIAMETER, 1/4" THREAD SIZE
 8. 15 TON, DUAL CIRCUIT (10/5) MODULAR PACKAGED COOLING OPTION FOR SIZE 3 MODULAR PACKAGED UNIT. INCLUDES CONDENSER, DX COIL, FILTER/DRYER KIT, THERMAL EXPANSION VALVE, R410A REFRIGERANT, AND REFRIGERANT PIPING.
 9. FULL CRATING FOR COMMERCIAL HEATERS FOR SHIPPING.
 10. DOWNTURN PLENUM FOR SIZE 3 COOLING COIL MODULE - REQUIRED FOR DOWN DISCHARGE COOLING COIL APPLICATIONS
 11. DX COOLING INTAKE AIR THERMOSTAT AND RELAYS MOUNTED IN UNIT - SET POINT FOR THERMOSTAT SHOULD BE 85°F.


NOTE: SUPPLY DUCT MUST BE INSTALLED TO MEET SMACNA STANDARDS. A MINIMUM STRAIGHT DUCT LENGTH MUST BE MAINTAINED DOWNSTREAM OF UNIT DISCHARGE UNLESS OTHERWISE SPECIFIED. DO NOT RELY ON UNIT TO SUPPORT DUCT IN ANY WAY. FAILURE TO PROPERLY SIZE DUCTWORK MAY CAUSE SYSTEM EFFECTS AND REDUCE PERFORMANCE OF THE EQUIPMENT.

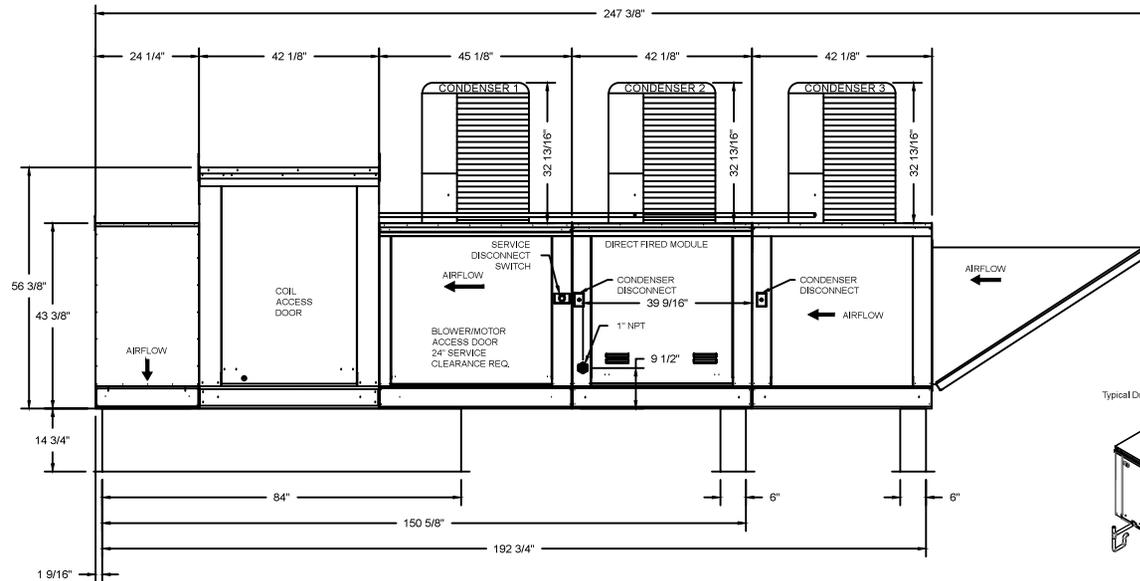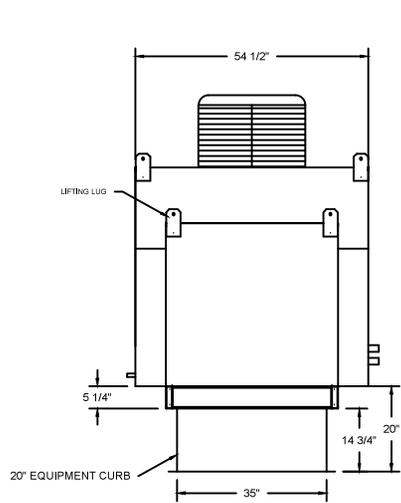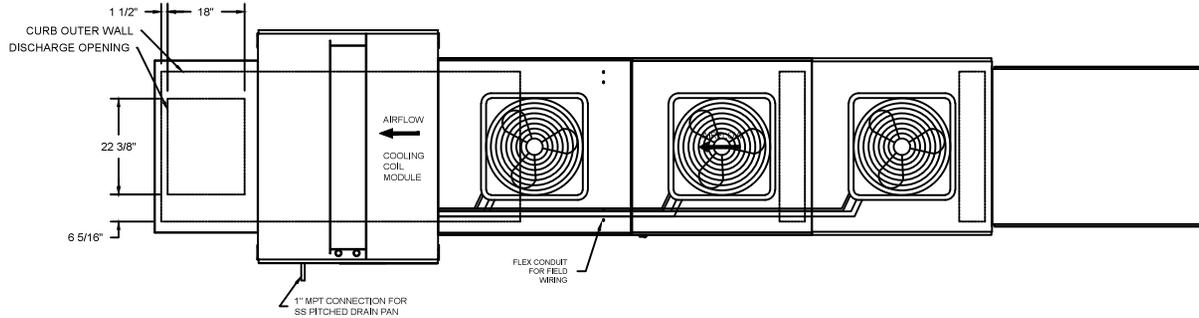

Typical Drain Trap Install



Recommended Cooling Coil Drain Trap Configuration



- Notes:
- 1) 1" diameter PVC Pipe only
 - 2) Use only low profile couplings
 - 3) Add clean out as shown




JOB	
LOCATION	
DATE	8/31/18
DWG #	JOB #
REV.	DRAWN BY
	SCALE

(MPU 7000 7.5HP/3PH-460V) - HEATER PERFORMANCE CURVES.

7000 CFM, 1.58 SP @ 1031 RPM and 5.773 BHP at 0 feet and 100 deg F

* Please note that these curves were adjusted for job specific temperature and altitude.

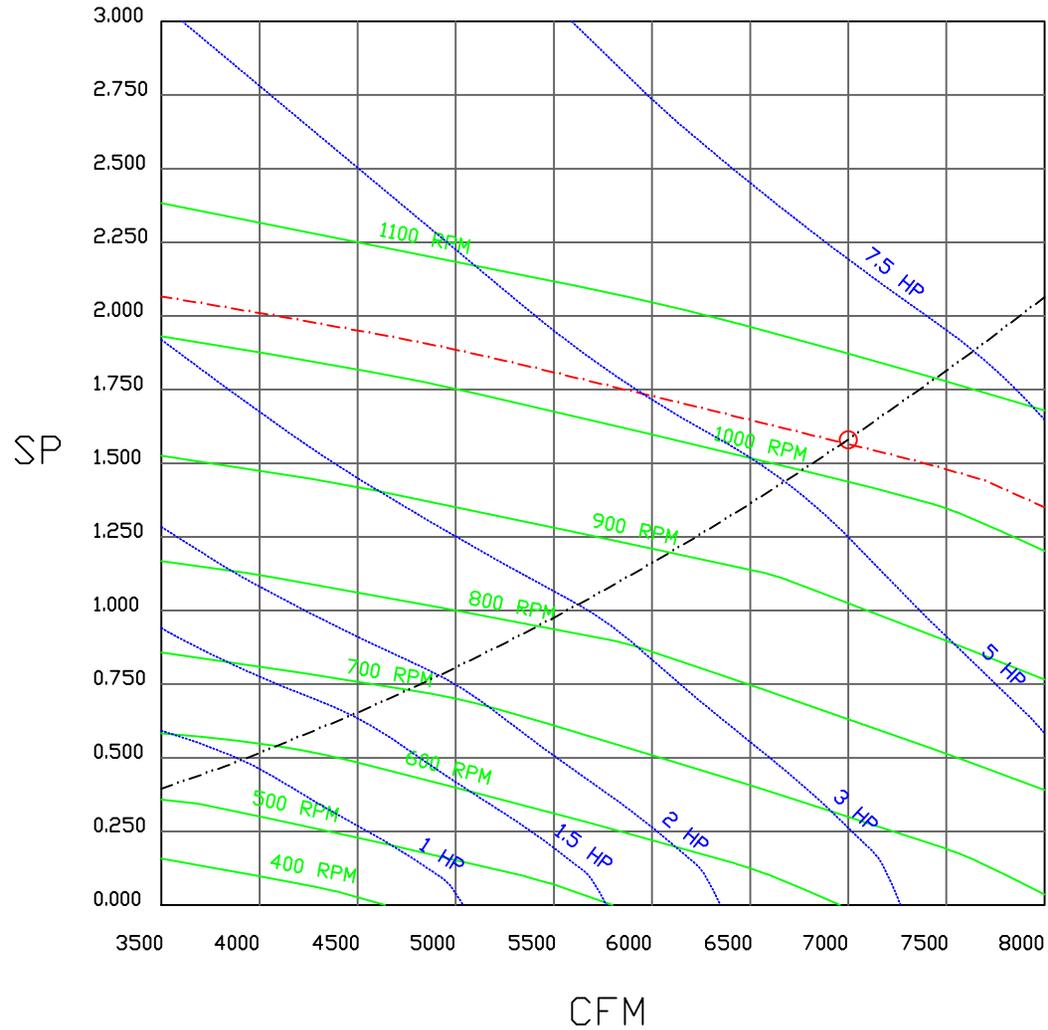

			JOB	
			LOCATION	
			DATE 8/27/2018	JOB #
			DWG #	DRAWN BY
			REV.	SCALE 3/8" = 1'-0"

Modular Package Unit Wiring

JOB NAKS DIRECT FIRED MPU

DRAWING NUMBER


SHIP DATE

MODEL TK 1-4 Series

ATTENTION ELECTRICIAN!
 DROP FOR DISCONNECT CONNECTION
 IS FACTORY SUPPLIED
 CONNECT POWER TO THE DROP

Installed Options
 Field Wired Single Switch Control
 Motorized Back Draft Damper

Discharge Temp. Control
 Cooling Thermostat and Relay

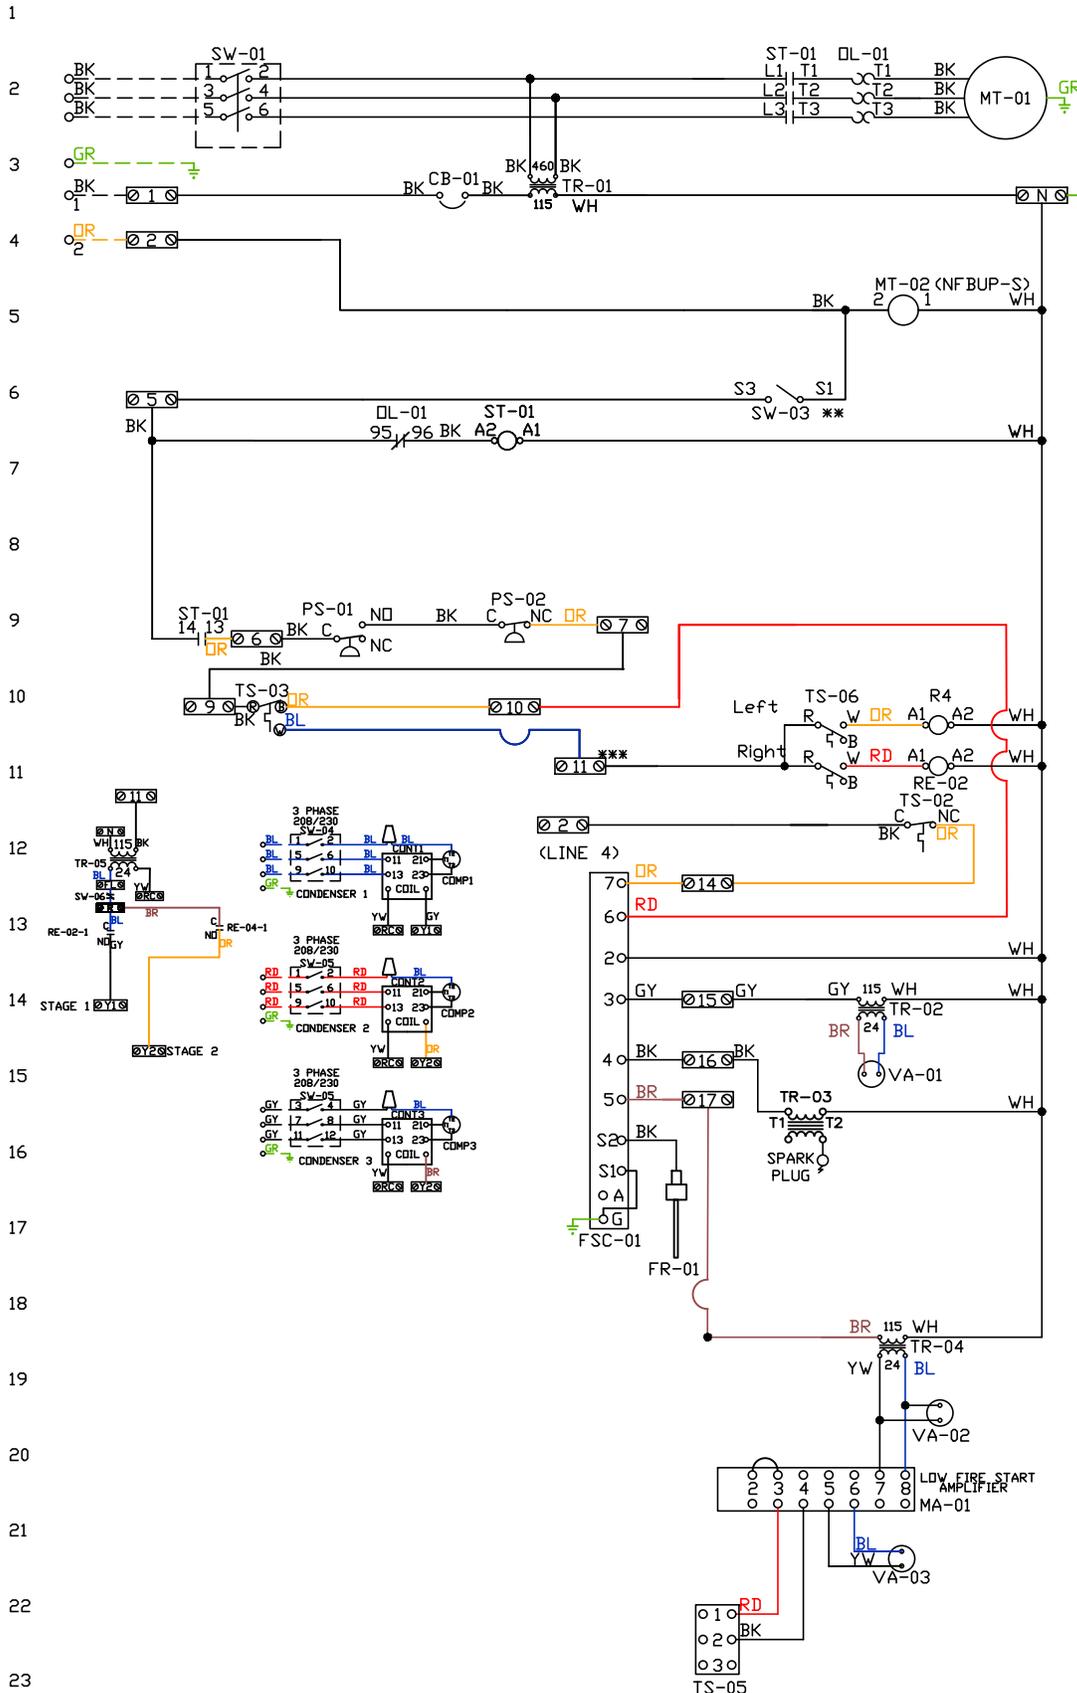

Label	Component Identification	Location
CB-01	Circuit breaker (2amp)	[3]

FR-01	Flame rod	[16]
FSC-01	Fireye FSC	[11][14]

MA-01	Modulating amplifier	[19]
MT-01	Supply motor	[2]
MT-02	Damper motor	[5]
DL-01	Supply motor overload	[2][7]

PS-01	Low Airflow Switch	[9]
PS-02	High Airflow Switch	[9]

RE-02	Stage 1 Heat/Cool Relay	[11][13]
RE-04	Stage 2 Cooling Relay	[11][13]

ST-01	Supply motor contactor	[2][7][9]
-------	------------------------	-----------

SW-01	Main disconnect switch	[2]
SW-03	Damper end limit switch	[4]
SW-04	40 Amp Rotary Disconnect	[12-14]
SW-05	40 Amp Rotary Disconnect	[14-15]
SW-06	Overflow Switch	[12-13]

TR-01	Power transformer(200v/53)	[12]
TR-02	Power transformer(20v)	[12]
TR-03	Ignition transformer	[14]
TR-04	Power transformer(20v)	[17]
TR-05	Cond Transformer(40v)	[12]

TS-02	High temp limit switch	[10]
TS-03	Intake Air Sensor	[10]
TS-05	Discharge Air Sensor	[21]
TS-06	Cooling Thermostat	[16]

VA-01	Pilot gas valve	[13]
VA-02	Main gas valve	[18]
VA-03	Modulating gas valve	[20]

SUPPLY	MOTOR INFO
CONTACTOR:	7.5HP-460V-3P-9.6FLA
OVERLOAD:	100-K12D10
	193-KC10

ELECTRICAL INFORMATION
 MOTOR/CTRL CIRCUIT MCA: 12.6A
 MOTOR/CTRL CIRCUIT MOP: 20A
 COND1 MCA = 21.4A COND1 MOP = 30A
 COND2 MCA = 21.4A COND2 MOP = 30A
 COND3 MCA = 21.4A COND3 MOP = 30A

NOTES
 - - - DENOTES FIELD WIRING
 _____ DENOTES INTERNAL WIRING

** TERMINALS S4 AND S6 USED ON
 NF & AF SERIES ACTUATORS
 *** TERMINAL 11 PROVIDES COOLING
 CONNECTION

WIRE COLOR	SOCKET STYLE
BK-BLACK	ND 4 3
BL-BLUE	NC 2 1
GR - GREEN	COIL 8 7
BR - BROWN	COM 6 5
GY - GRAY	
WH - WHITE	
PR - PURPLE	
RD - RED	
YW - YELLOW	
PK - PINK	

Installation Wiring




JOB NAKS Direct Fired MPU

DRAWING NUMBER



SHIP DATE

MODEL TK 1-4 Series


Installed Options

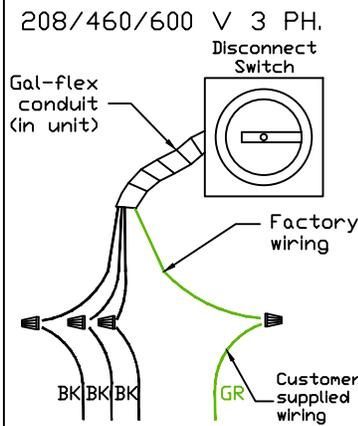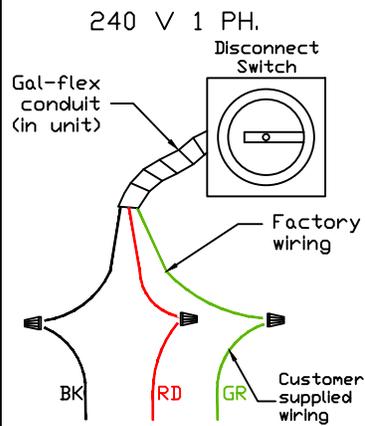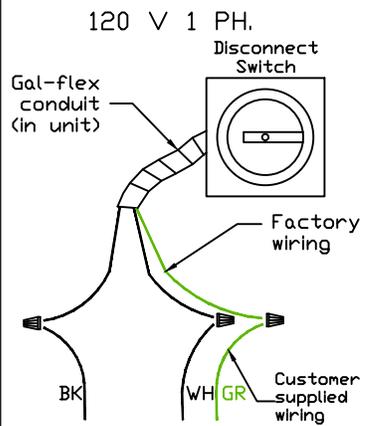

Field Wired On/Off Switch

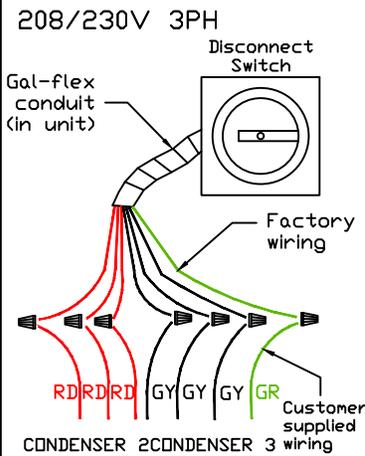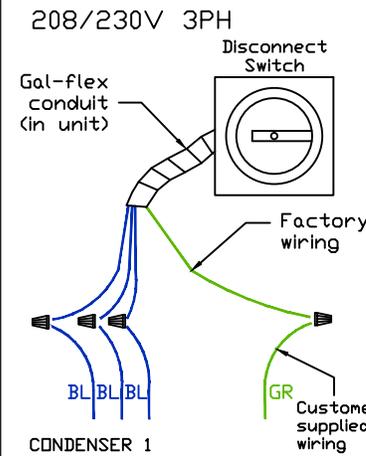

DO NOT CONNECT CONDENSER POWER DROPS TO KITCHEN CONTROL PACKAGE STARTERS OR VFDS

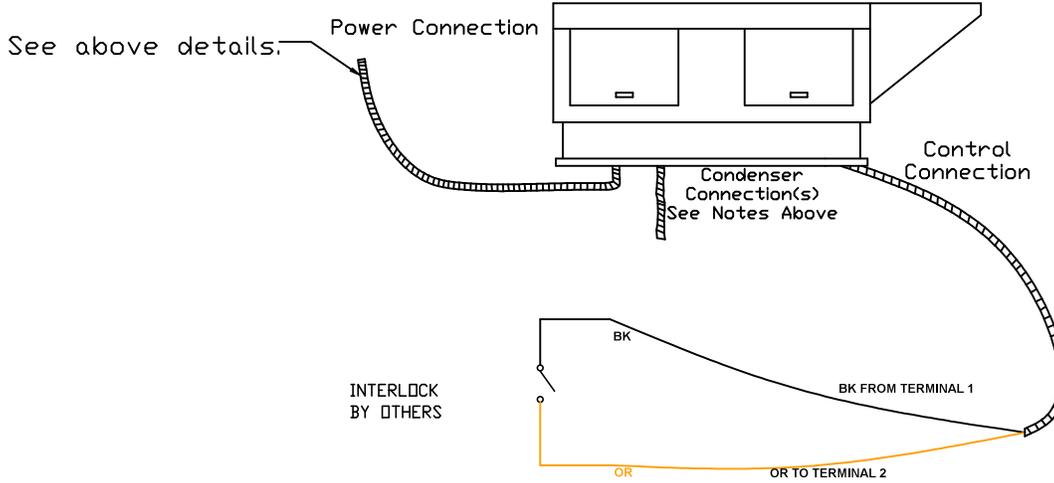

NOTES

WIRE COLOR

- | | |
|-------------|-------------|
| BK - BLACK | YW - YELLOW |
| BL - BLUE | GR - GREEN |
| BR - BROWN | GY - GRAY |
| OR - ORANGE | PR - PURPLE |
| RD - RED | PK - PINK |
| WH - WHITE | |